

FIG. 1

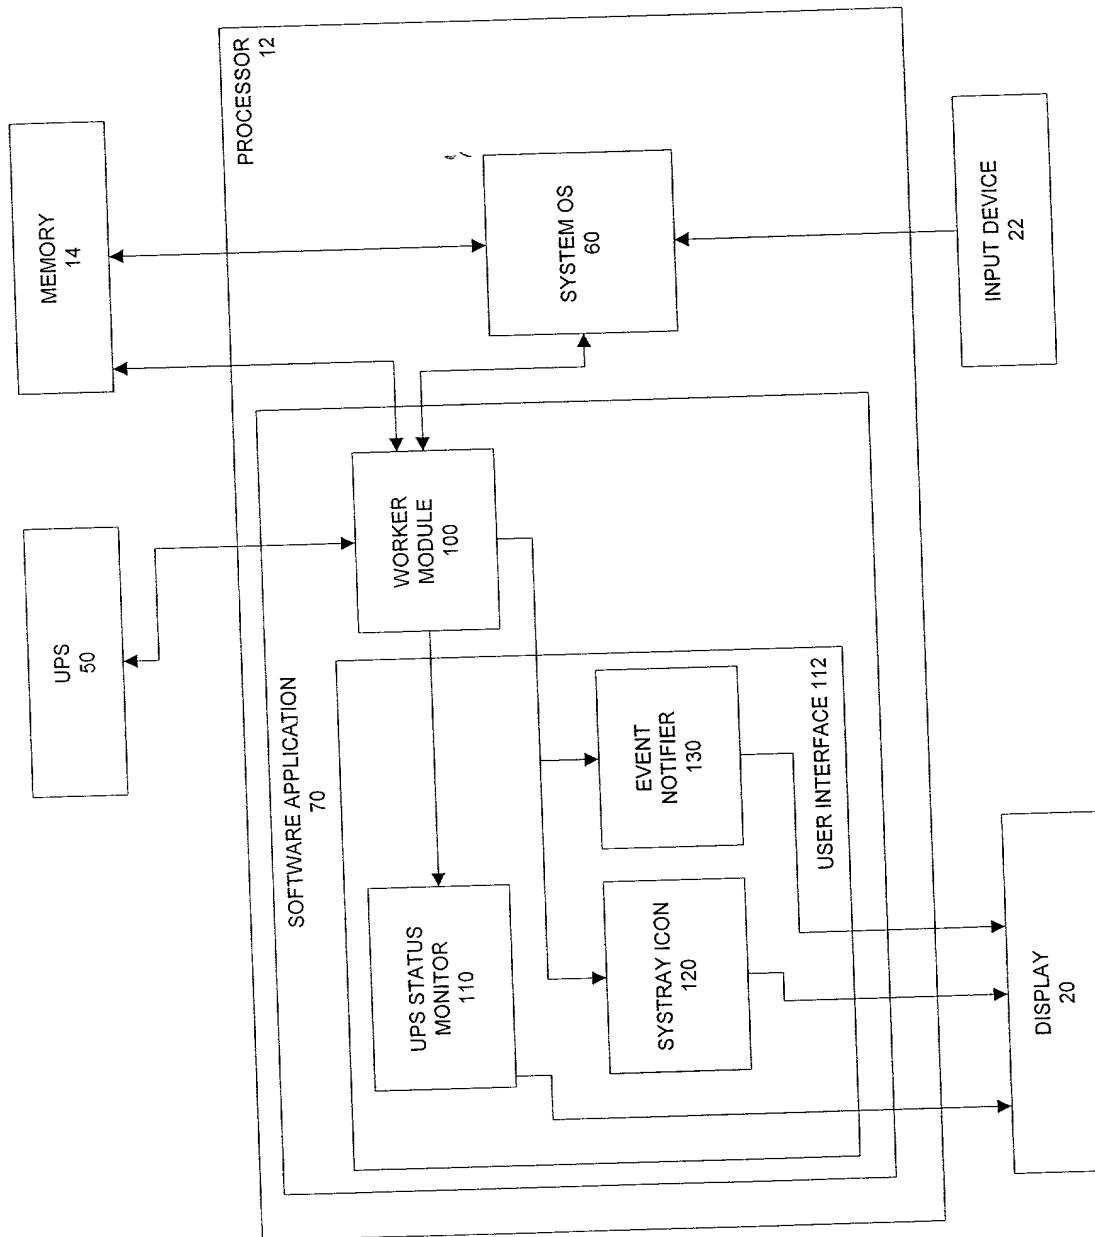


FIG. 2


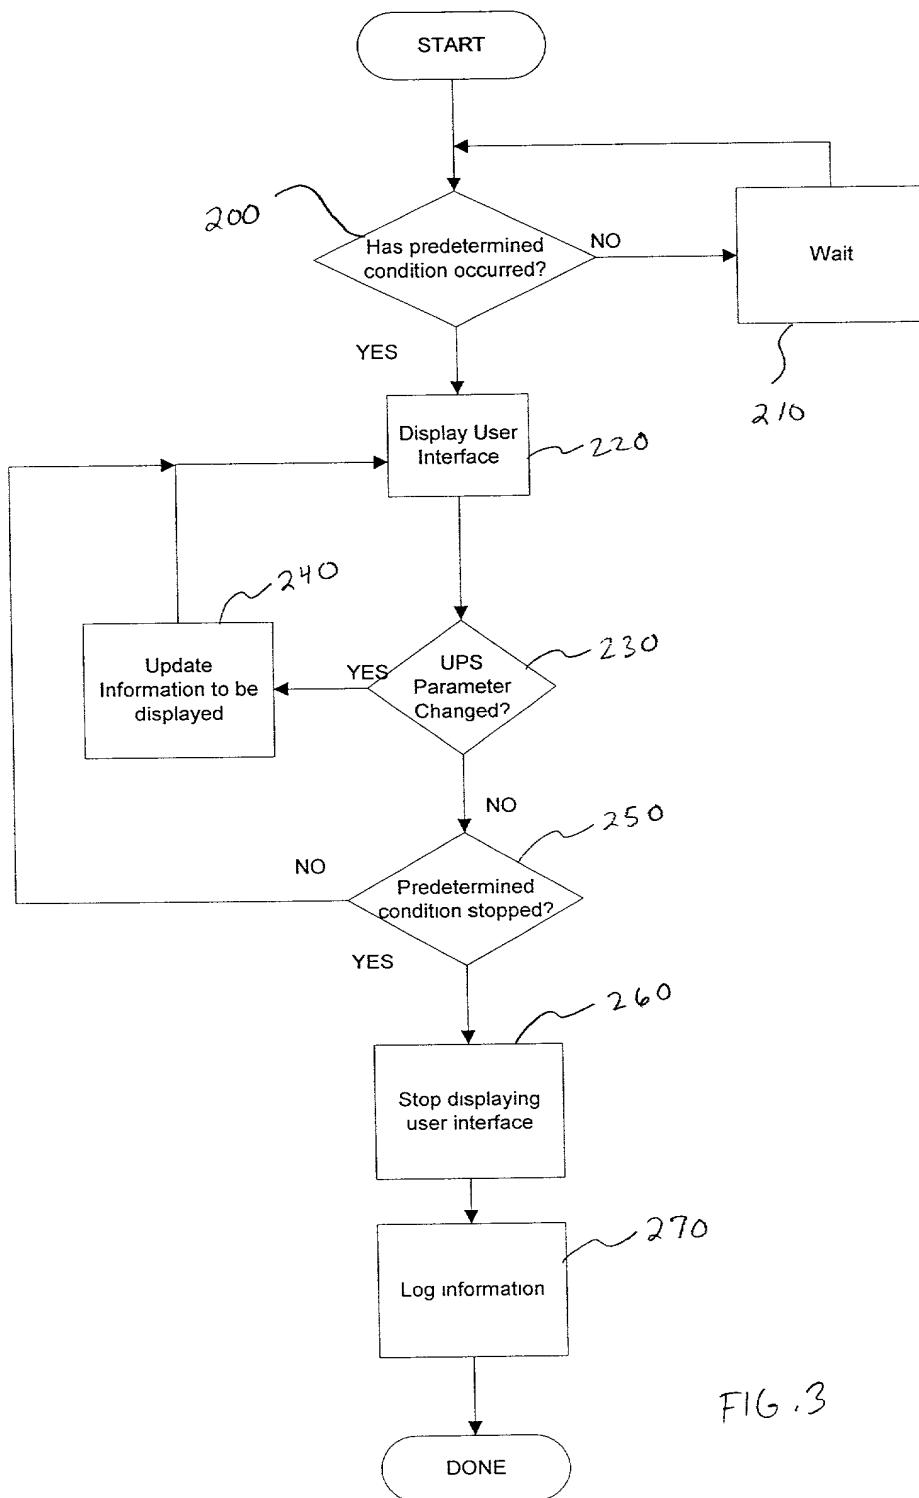


FIG. 3

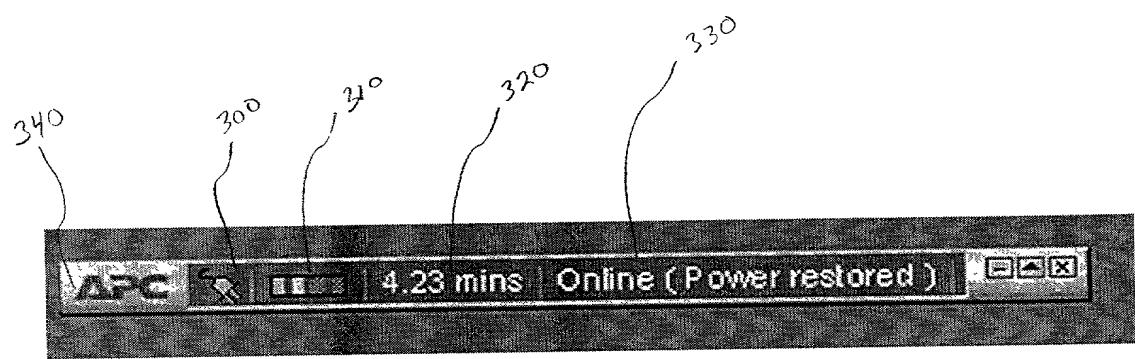

110

FIG. 4A


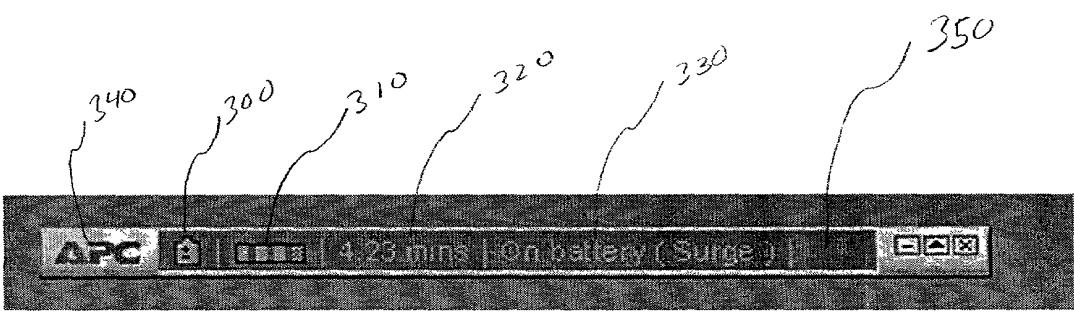


FIG. 4B

110

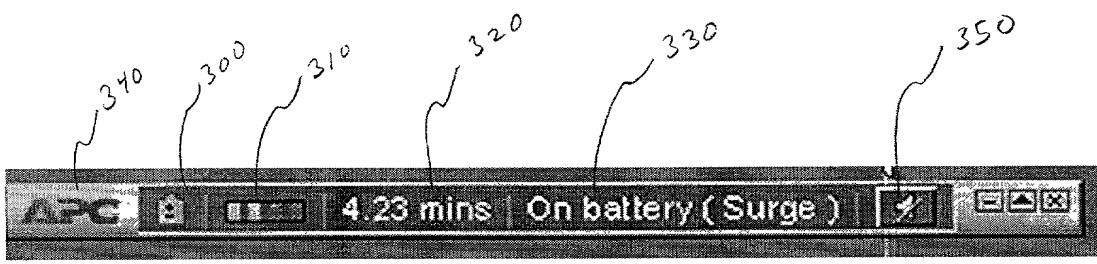

110

FIG. 4C

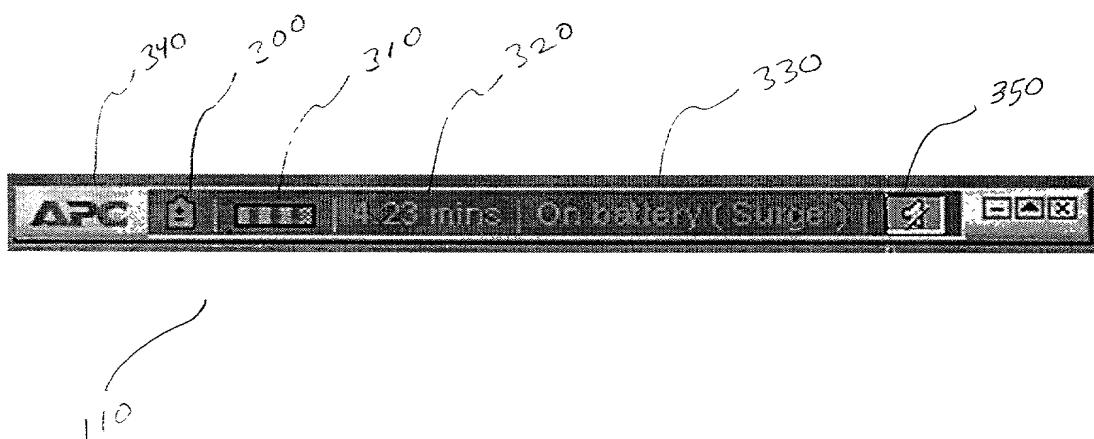


FIG. 4D

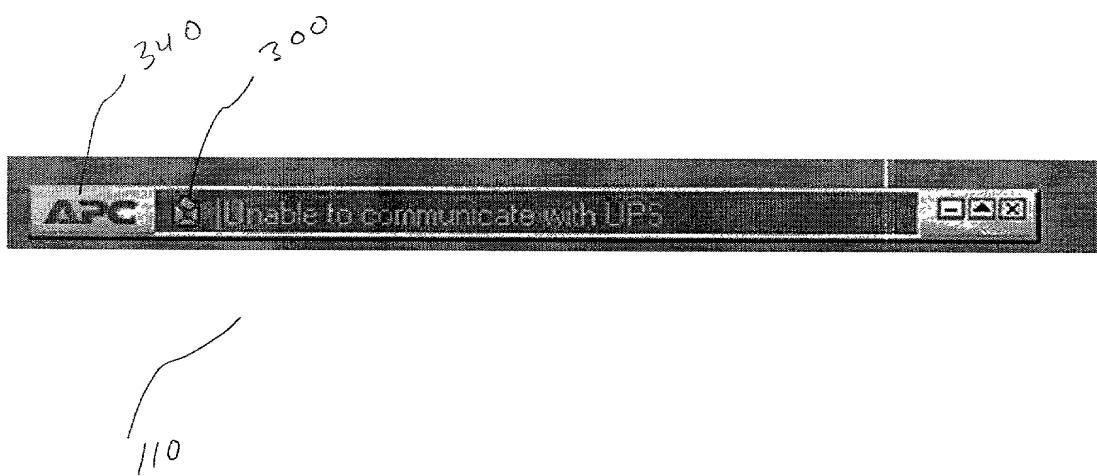


FIG. 5



126

FIG. 6



FIG. 7

20




FIG. 8

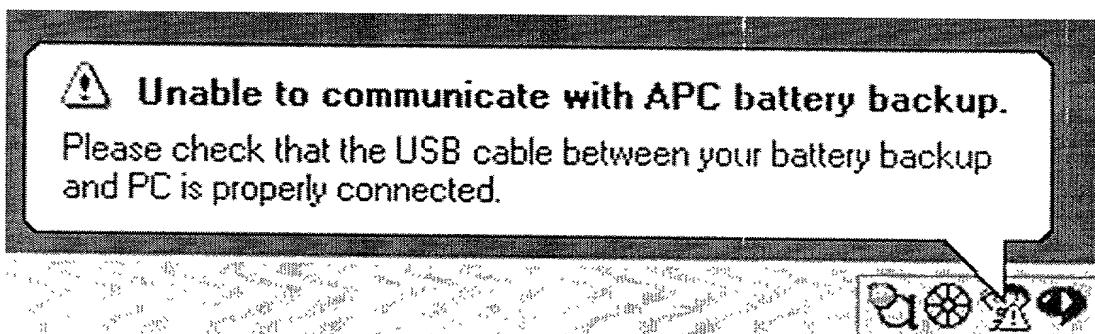


FIG. 9

400

PowerChute Personal Edition

Monitor System Configuration Help

Performance Current Status Run Self Test

APC

Performance Summary

- ✓ Your battery backup last intervened on 31/10/2001, at 17:48:06
- ✓ PowerChute performed 1 managed shutdown of the operating system.
- ✓ PowerChute last performed a self-test on 31/10/2001 - No problems were found

Power Problem History

View performance information for the last

Power problem	Your unit switched to battery power	Time on battery (approx)
Blackout	21 times	13 minutes, 31 seconds
Under voltage	2 times	10 seconds
Over voltage	2 times	10 seconds
Electrical noise	None	Never
Total:	25 times	13 minutes, 51 seconds

Power Source **Battery Capacity** **Estimated Battery Time**

AC Utility 68% 110 min

Your battery backup is performing normally.

FIG. 10